






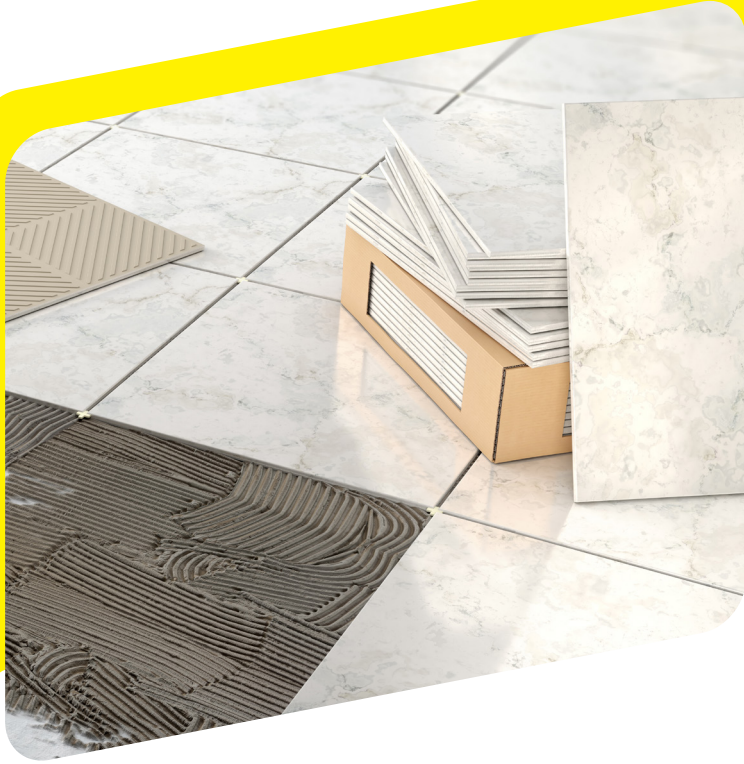

webertai fix
High quality tile adhesive with double bonding strength


-  Laying ceramic tiles, clay tiles, granto tiles, marbles, granites. Laying clay tiles in small swimming pool.
-  Double bonding strength  LEED
-  With special additive providing anti-slip property  TIS Standard General Quality Class
-  Low VOCs

webertai fix is pre-mixed high quality tile adhesive to mix with water giving double bonding strength for laying tiles on both floor and wall

APPLICATION
Substrate preparation

- Substrate should be sound, level, and clean with normal absorption rate
- In case of porous substrate with high absorption, dampen the surface before tiling
- For new render or screed, it should be fully cured at the rate of 7 days per 1 cm thickness before tiling

Mixing

Mixing **webertai fix** in water with the ratio of 1:3 by volume (1 part of water + 3 parts of webertai fix). Using slow-speed electric mixer to mix or gradually mix by hand until obtaining homogeneous lump-free paste. Leave for 3 – 4 minutes for chemical curing before using.

Tiling

1. Using notched trowel to spread tile adhesive onto substrate
2. Back buttering in case of laying tile bigger than 10 x 10 inches
3. Placing tiles on tile adhesive and knock gradually with rubber hammer
4. Clean the excess tile adhesive on tile surface
5. Tiles can be adjusted within 15 minutes after laying
6. Leave for 24 hours before grouting

SHELF LIFE AND STORAGE

One year after manufacturing date when stored unopened in dry and ventilated place. Store airtight in dry and ventilated conditions if remained in opened bag



SUITABLE FOR : ceramic tiles, clay tiles, granto tiles, marbles, granites

PACKAGING : 20 kg bag and 25 kg bag

COLOR : grey

COVERAGE :
average 4-7 m²/20 kg bag
average 5-9 m²/25 kg bag

TECHNICAL DATA	
Type	Standard tile adhesive
Density of powder	140 g/cm ³
Chemical curing time	3 – 4 minutes
Pot life (in shade)	4 hours
Open time	20 minutes
Adjusting time	10 minutes
Recommended thickness	2 – 10 mm
Waiting time before grouting	24 hours

Remark: These test results are from laboratory test. They could be slightly different from on-site results because of the differences in applications and conditions

CERTIFIED STANDARD		
International/European standard	Standard	Result
Initial tensile adhesion strength ISO 13007 part 2-4.4.4.2 or EN 1348-8.2	≥ 0.5 N/mm ²	144 N/mm ²
Tensile adhesion strength after water immersion ISO 13007 part 2-4.4.4.3 or EN 1348-8.3	≥ 0.5 N/mm ²	1.66 N/mm ²
Tensile adhesion strength after heat ageing ISO 13007 part 2-4.4.4.4 หรือ (EN 1348-8.4)	≥ 0.5 N/mm ²	0.62 N/mm ²
Open time tensile adhesion strength ISO 13007 part 2-4.1 or EN 1346	≥ 0.5 N/mm ²	1.43 N/mm ²
American Standard	Standard	Result
Shear strength according to ANSI A 118.1 – 2012		
- To glazed wall tiles	7 days	> 1.38 MPa
- To porcelain mosaics	1 day	> 0.34 MPa
	7 days	> 1.03 MPa
	28 days	> 1.03 MPa
	84 days	> 1.03 MPa
Water immersion shear strength according to ANSI A 118.1 – 2012		
- To glaze wall tiles	7 days	> 1.03 MPa
- To porcelain mosaic	7 days	> 0.69 MPa



AIT

Asian Institute of Technology

Structural Engineering Laboratory

Postal Address:
P.O.Box 4, Klong Luang
Pathumthani 12120
Thailand

Street Address:
Km. 42, Paholyothin Highway
Klong Luang, Pathumthani 12120
Thailand

Tel: +(66-2) 524-6427, 5527
Fax: +(66-2) 524-5544
http://www.ait.asia

EXECUTIVE SUMMARY

The Structural Engineering Laboratory, School of Engineering and Technology, Asian Institute of Technology (AIT) was engaged by the SAINT-GOBAIN WEBER CO., LTD. to conduct the performance test of cementitious tile adhesive. The sample with a trademark of "Webertai fix" was provided by the SAINT-GOBAIN WEBER CO., LTD. The water to "Webertai fix" ratio was 27% by weight. The series of tests were according to ISO 13007 / European Norms (EN 12004:2007+A1:2012) as follows: Specification of cementitious adhesives

Fundamental Characteristics

1a Normal setting adhesives			
Characteristic	Requirement	Test Method	Results
Tensile adhesion strength Reference No: S0496A-23	$\geq 0.5 \text{ N/mm}^2$	ISO 13007 part 2 4.4.4.2 or EN 1348 § 8.2	1.44 N/mm^2 PASS
Tensile adhesion strength after water immersion Reference No: S0496B-23	$\geq 0.5 \text{ N/mm}^2$	ISO 13007 part 2 4.4.4.3 or EN 1348 § 8.3	1.66 N/mm^2 PASS
Tensile adhesion strength after heat ageing Reference No: S0496C-23	$\geq 0.5 \text{ N/mm}^2$	ISO 13007 part 2 4.4.4.4 or EN 1348 § 8.3	0.62 N/mm^2 PASS
Open time : tensile adhesion strength Reference No: S0496D-23	$\geq 0.5 \text{ N/mm}^2$ after not less than 20 min	ISO 13007 part 2 4.1 or EN 1346	1.43 N/mm^2 PASS

From test results, it is found that the properties of "Webertai fix" are conformed to ISO 13007 / European Norms (EN 12004:2007+A1:2012) requirement. These results certify the adequacy and representative characteristic of the test samples only.

Tested Date: September 22, 2023

Checked & Approved by:



DR. ANAWAT CHOTESUWAN
SENIOR LABORATORY SUPERVISOR
November 2, 2023

AIT

Asian Institute of Technology

Km. 42 Paholyothin Highway, Klong Luang, Pathumthani, Thailand 12120

P. O. Box 4 Klong Luang, Pathumthani 12120, Thailand. Tel. (66-2) 524-5527, 524-6427 Fax. (66-2) 524-5544

STRUCTURAL ENGINEERING LABORATORY

STRUCTURAL ENGINEERING FIELD OF STUDY


SCHOOL OF ENGINEERING AND TECHNOLOGY

TYPE OF TEST: INITIAL ADHESION STRENGTH (EN 1348:2007)**TEST SPECIMEN:** Ten (10) specimens of unglazed floor tile of size 50 x 50 x 5 mm. installed by using "Webertai fix" were prepared in the SE laboratory. The mix proportion of water to "Webertai fix" ratio was 27% by weight.**CLIENT:** SAINT-GOBAIN WEBER CO., LTD.**DATE OF TEST:** September 22, 2023**DATE OF PREPARATION :** August 25, 2023**TEST METHOD:** After finish the preparation, the test units were placed in standard conditions for 27 days. Bond the pull head plate to the tile with the high strength epoxy and keep the test units for a further 24 hour in standard condition. Determine the tensile adhesive strength.**TEST RESULTS:**

Specimen No.	Width of Specimen (mm.)	Length of Specimen (mm.)	Area (mm ²)	Maximum Load (N.)	Tensile Adhesion Strength (N/mm ²)	Remarks
1	50.03	50.03	2,503	3,596	1.44	Cohesive failure within the adhesive
2	50.03	50.03	2,503	4,310	1.72	
3	50.03	50.03	2,503	3,633	1.45	
4	50.03	50.03	2,503	3,395	1.36	
5	50.03	50.03	2,503	3,668	1.47	
6	50.03	50.03	2,503	3,113	1.24	
7	50.03	50.03	2,503	3,588	1.43	
8	50.03	50.03	2,503	3,432	1.37	
9	50.03	50.03	2,503	3,732	1.49	
10	50.03	50.03	2,503	3,486	1.39	
				Average	1.44	

Note: This report certifies the adequacy and representative character of the test sample(s) only.

TESTED BY:

**MR. RUNGROJ JANGJIT**
TECHNICIAN

CHECKED & APPROVED BY:

**DR. ANAWAT CHOTESUWAN**
SENIOR LABORATORY SUPERVISOR
November 2, 2023

AIT

Asian Institute of Technology

Km. 42 Paholyothin Highway, Klong Luang, Pathumthani, Thailand 12120

P. O. Box 4 Klong Luang, Pathumthani 12120, Thailand. Tel. (66-2) 524-5527, 524-6427 Fax. (66-2) 524-5544

STRUCTURAL ENGINEERING LABORATORY

STRUCTURAL ENGINEERING FIELD OF STUDY

SCHOOL OF ENGINEERING AND TECHNOLOGY

TYPE OF TEST: ADHESIVE STRENGTH AFTER WATER IMMERSION (EN1348:2007)**TEST SPECIMEN:** Ten (10) specimens of unglazed floor tile of size 50 x 50 x 5 mm. installed by using "Webertai fix" were prepared in the SE laboratory. The mix proportion of water to "Webertai fix" ratio was 27% by weight.**CLIENT:** SAINT-GOBAIN WEBER CO., LTD.**DATE OF TEST:** September 22, 2023**DATE OF PREPARATION :** August 25, 2023**TEST METHOD:** After finish the preparation, the test units were placed in standard conditions for 7 days and stored in water for 20 days. Bond the pull head plate to the tile with the high strength epoxy and keep the test units for a further 24 hour in in water at the standard temperature. Determine the tensile adhesive strength.**TEST RESULTS:**

Specimen No.	Width of Specimen (mm.)	Length of Specimen (mm.)	Area (mm ²)	Maximum Load (N.)	Tensile Adhesion Strength (N/mm ²)	Remarks
1	50.03	50.03	2,503	4,427	1.77	Cohesive failure within the adhesive
2	50.03	50.03	2,503	3,521	1.41	Cohesive failure within the adhesive
3	50.03	50.03	2,503	4,682	1.87	Cohesive failure within the adhesive
4	50.03	50.03	2,503	4,147	1.66	Cohesive failure within the adhesive
5	50.03	50.03	2,503	3,313	1.32	Cohesive failure within the adhesive
6	50.03	50.03	2,503	3,562	1.42	Cohesive failure within the adhesive
7	50.03	50.03	2,503	4,048	1.62	Cohesive failure within the adhesive
8	50.03	50.03	2,503	4,181	1.67	Cohesive failure within the adhesive
9	50.03	50.03	2,503	4,681	1.87	Cohesive failure within the adhesive
10	50.03	50.03	2,503	5,100	2.04	Cohesive failure within the adhesive
				Average	1.66	

Note: This report certifies the adequacy and representative character of the test sample(s) only.

TESTED BY:



MR. RUNGROJ JANGJIT
TECHNICIAN

CHECKED & APPROVED BY:



DR. ANAWAT CHOTESUWAN
SENIOR LABORATORY SUPERVISOR
November 2, 2023

Asian Institute of Technology

 Km. 42 Paholyothin Highway, Klong Luang, Pathumthani, Thailand 12120
 P. O. Box 4 Klong Luang, Pathumthani 12120, Thailand. Tel. (66-2) 524-5527, 524-6427

STRUCTURAL ENGINEERING LABORATORY
STRUCTURAL ENGINEERING FIELD OF STUDY
SCHOOL OF ENGINEERING AND TECHNOLOGY
TYPE OF TEST: OPEN TIME (EN1346) AFTER 20 MINUTES

TEST SPECIMEN: Ten (10) specimens of unglazed floor tile of size 50 x 50 x 5 mm. installed by using "Webertal fix" were prepared in the SE laboratory. The mix proportion of water to "Webertal fix" ratio was 27% by weight.

CLIENT: SAINT-GOBAIN WEBER CO., LTD.

DATE OF TEST: September 22, 2023 **DATE OF PREPARATION :** August 25, 2023

TEST METHOD: Apply a thin layer of the adhesive to the concrete slab with a straight edge trowel. After 20 minutes place the tiles on the adhesive and store them under standard conditions for 27 days. Bond the pull head plates to the tiles with the high strength epoxy and keep the test units for a further 24 hour in standard condition. Determine the tensile adhesive strength.

TEST RESULTS:

Specimen No.	Width of Specimen (mm.)	Length of Specimen (mm.)	Area (mm ²)	Maximum Load (N.)	Tensile Adhesion Strength (N/mm ²)	Remarks
1	50.03	50.03	2,503	3,725	1.49	Cohesive failure within the adhesive
2	50.03	50.03	2,503	3,802	1.52	Cohesive failure within the adhesive
3	50.03	50.03	2,503	3,814	1.52	Cohesive failure within the adhesive
4	50.03	50.03	2,503	3,156	1.26	Cohesive failure within the adhesive
5	50.03	50.03	2,503	3,479	1.39	Cohesive failure within the adhesive
6	50.03	50.03	2,503	3,063	1.22	Cohesive failure within the adhesive
7	50.03	50.03	2,503	3,375	1.35	Cohesive failure within the adhesive
8	50.03	50.03	2,503	3,764	1.50	Cohesive failure within the adhesive
9	50.03	50.03	2,503	3,717	1.48	Cohesive failure within the adhesive
10	50.03	50.03	2,503	3,834	1.53	Cohesive failure within the adhesive
					Average	1.43

Note: This report certifies the adequacy and representative character of the test sample(s) only.

TESTED BY:


MR. RUNGROJ JANGJIT
 TECHNICIAN

CHECKED & APPROVED BY:


DR. ANAWAT CHOTESUWAN
 SENIOR LABORATORY SUPERVISOR
 November 2, 2023

Asian Institute of Technology

 Km. 42 Paholyothin Highway, Klong Luang, Pathumthani, Thailand 12120
 P. O. Box 4 Klong Luang, Pathumthani 12120, Thailand. Tel. (66-2) 524-5527, 524-6427 Fax. (66-2) 524-5544

STRUCTURAL ENGINEERING LABORATORY
STRUCTURAL ENGINEERING FIELD OF STUDY
SCHOOL OF ENGINEERING AND TECHNOLOGY
TYPE OF TEST: ADHESIVE STRENGTH AFTER HEAT AGEING (EN1348:2007)

TEST SPECIMEN: Ten (10) specimens of unglazed floor tile of size 50 x 50 x 5 mm. installed by using "Webertal fix" were prepared in the SE laboratory. The mix proportion of water to "Webertal fix" ratio was 27% by weight.

CLIENT: SAINT-GOBAIN WEBER CO., LTD.

DATE OF TEST: September 22, 2023 **DATE OF PREPARATION :** August 25, 2023

TEST METHOD: After finish the preparation, the test units were placed in standard conditions for 14 days and then place in oven at 70 ± 2 °C for 13 days. Remove from the oven and bond the pull head plate to the tile with the high strength epoxy. Keep the test units for a further 24 hour in standard condition. Determine the tensile adhesive strength.

TEST RESULTS:

Specimen No.	Width of Specimen (mm.)	Length of Specimen (mm.)	Area (mm ²)	Maximum Load (N.)	Tensile Adhesion Strength (N/mm ²)	Remarks
1	50.03	50.03	2,503	1,513	0.60	Cohesive failure within the adhesive
2	50.03	50.03	2,503	1,347	0.54	Cohesive failure within the adhesive
3	50.03	50.03	2,503	1,554	0.62	Cohesive failure within the adhesive
4	50.03	50.03	2,503	1,496	0.60	Cohesive failure within the adhesive
5	50.03	50.03	2,503	1,887	0.75	Cohesive failure within the adhesive
6	50.03	50.03	2,503	1,370	0.55	Adhesive failure between tile and adhesive
7	50.03	50.03	2,503	1,319	0.53	Adhesive failure between tile and adhesive
8	50.03	50.03	2,503	1,602	0.64	Cohesive failure within the adhesive
9	50.03	50.03	2,503	1,443	0.58	Cohesive failure within the adhesive
10	50.03	50.03	2,503	2,044	0.82	Cohesive failure within the adhesive
					Average	0.62

Note: This report certifies the adequacy and representative character of the test sample(s) only.

TESTED BY:


MR. RUNGROJ JANGJIT
 TECHNICIAN

CHECKED & APPROVED BY:


DR. ANAWAT CHOTESUWAN
 SENIOR LABORATORY SUPERVISOR
 November 2, 2023



CENTRO TECNOLÓGICO DA CERÂMICA E DO VIDRO
 IParque - Parque Tecnológico de Coimbra - Lotes 6 e 7
 3006-540 ANFANHOL | Portugal
 T +351 239499200
 centroctcvpt
 www.ctcvpt

ÍNDICE

Os resultados apresentados neste trabalho referem-se apenas às amostras ensaiadas. Não se assume qualquer responsabilidade relativa à exatidão da amostragem, a menos que seja referida sob a directa responsabilidade do CTCV. A reprodução deste trabalho é autorizada apenas na sua forma integral. Para qualquer reprodução parcial será indispensável autorização do CTCV por escrito.

AIM.....	3
1. INTRODUCTION.....	3
2. METHODOLOGY	3
2.1. TESTS	3
2.2. TEST RESULTS.....	4
3. COMPARATION WITH STANDARD REQUIREMENTS	6



CENTRO TECNOLÓGICO DA CERÂMICA E DO VIDRO
 IParque - Parque Tecnológico de Coimbra - Lotes 6 e 7
 3006-540 ANFANHOL | Portugal
 T +351 239499200
 centroctcvpt
 www.ctcvpt

Tests of dry-set cement mortar according ANSI A118.1:2012 - weber tai.fix

Working report Nº 315.37004-02/18

Client: Saint-Gobain Weber Co., Ltd - Thailand
 Contact at client: Kanchana LOCOLAS
 Contact at CTCV: J. Valente de Almeida
 Work period: January - May 2018



CENTRO TECNOLÓGICO DA CERÂMICA E DO VIDRO
 Rua Nova, Parque Tecnológico de Coimbra - Lote 6 e 7 | centro_PT501.632.174
 3040-540 ANTANHOI | Portugal | T +351 239499200
 Rua Coronel Nogueira Simão - Lote 6 (leste) | centroctcv.pt
 3025-307 COIMBRA | Portugal | www.ctcv.pt

Table 1 - Tests according ANSI A118.1

Property	Test duration and/or conditions
Glazed wall tile shear strength (A1)	7 days 7 days water immersion
Porcelain mosaic tile shear strength (C)	1 day 7 days 7 days water immersion 28 days 12 weeks

2.2. Test results

The test results are presented at table 2.

Os resultados apresentados neste Trabalho referem-se apenas às amostras ensaiadas. Não se assume qualquer responsabilidade relativa à exatidão da amostragem, a menos que seja efetuada sob a direção e responsabilidade do CTCV. A reprodução deste Trabalho é autorizada apenas na sua forma integral. Para qualquer reprodução parcial será indispensável autorização do CTCV por escrito.

Proj. nº 315.37004

Rep. nº 02

Revision: 0

Date: June 2018

Página 4 de 4



CENTRO TECNOLÓGICO DA CERÂMICA E DO VIDRO
 Rua Nova, Parque Tecnológico de Coimbra - Lote 6 e 7 | centro_PT501.632.174
 3040-540 ANTANHOI | Portugal | T +351 239499200
 Rua Coronel Nogueira Simão - Lote 6 (leste) | centroctcv.pt
 3025-307 COIMBRA | Portugal | www.ctcv.pt

Tests of dry-set cement mortar according ANSI A118.1:2012 - weber tai.fix

Saint Gobain Weber Co Ltd - Thailand

Aim

Evaluate compliance of the test results with the requirements of ANSI A118.1: 2012¹.

1. Introduction

Saint Gobain Weber Co Ltd - Thailand requested the CTCV to carry out tests on dry-set cement mortar - weber tai.fix - in accordance with the American Standard ANSI A118.1.

This report presents the methodology of the tests, the results of the tests carried out and their comparison with the applicable regulatory requirements

2. Methodology

The methodology used in the study was the following:

- carrying out the tests
- processing of data
- reporting

2.1. Tests

The tests carried out are presented at table 1.

Os resultados apresentados neste Trabalho referem-se apenas às amostras ensaiadas. Não se assume qualquer responsabilidade relativa à exatidão da amostragem, a menos que seja efetuada sob a direção e responsabilidade do CTCV. A reprodução deste Trabalho é autorizada apenas na sua forma integral. Para qualquer reprodução parcial será indispensável autorização do CTCV por escrito.

1 ANSI A118.1:2012 - American National Standard Specifications for Dry-Set Cement Mortar.

Proj. nº 315.37004

Rep. nº 02

Revision: 0

Date: June 2018

Página 3 de 3



CENTRO TECNOLÓGICO DA CERÂMICA E DO VIDRO
 Rua, Rua Tecnológica de Coimbra - Lote 6 e 7 | cont. PT 501 632 174
 3005-510 AVANHOD | Portugal | T +351 239499200
 Rua, Rua Tecnológica de Coimbra - Lote 6 e 7 | cont. PT 501 632 174
 3005-510 AVANHOD | Portugal | T +351 239499200
 www.ctcv.pt

3. Comparison with standard requirements

The comparison of test results with standard requirements is presented at Table 3.

Table 3 - Comparison of test results with standard requirements

Ceramic	Test duration/condition	Test result (MPa)	Requirements (MPa)	Compliance
A1	Shear initial, 7d	1,63	>1,38	Complies
	Shear, after 7 d water immersion	1,75	>1,03	Complies
	Shear initial, 1d	0,49	>0,34	Complies
C	Shear initial, 7d	2,03	>1,03	Complies
	Shear initial, 28d	2,22	>1,03	Complies
	Shear, after 7 day water immersion	2,61	>1,03	Complies
	Shear, after 7 day water immersion	2,26	>0,69	Complies

Coimbra, 04 June 2018

JVM
 Joaquim Valente de Almeida

Testing Materials Laboratory

Os resultados apresentados neste trabalho referem-se apenas às amostras ensaiadas. Não se assume qualquer responsabilidade relativa à validade da amostragem, a menos que seja efetuada sob a direta responsabilidade do CTCV. A reprodução deste trabalho é autorizada apenas na sua forma íntegra. Para qualquer reprodução parcial será indispensável a autorização do CTCV por escrito.



CENTRO TECNOLÓGICO DA CERÂMICA E DO VIDRO
 Rua, Rua Tecnológica de Coimbra - Lote 6 e 7 | cont. PT 501 632 174
 3005-510 AVANHOD | Portugal | T +351 239499200
 Rua, Rua Tecnológica de Coimbra - Lote 6 e 7 | cont. PT 501 632 174
 3005-510 AVANHOD | Portugal | T +351 239499200
 www.ctcv.pt

Table 2 - Test results

Ceramic	Test duration/condition	Specimen	Force (kN)	Tension (MPa)	Average (MPa)
A1	Shear initial, 7d	1	8,93	1,73	1,63
		2	7,36	1,43	
		3	8,07	1,56	
		4	9,21	1,78	
	Shear, after 7 d water immersion	1	9,29	1,80	1,75
		2	10,20	1,98	
		3	8,32	1,61	
		4	8,40	1,63	
	Shear initial, 1d	1	0,89	0,48	0,49
		2	1,05	0,56	
		3	0,78	0,42	
		4	0,98	0,52	
	Shear initial, 7d	1	2,71	1,45	2,03
		2	4,10	2,19	
		3	3,67	1,96	
		4	4,72	2,52	
C	Shear initial, 28d	1	5,47	2,93	2,22
		2	3,40	1,82	
		3	3,76	2,01	
		4	4,00	2,14	
	Shear initial, 12 weeks	1	4,93	2,64	2,61
		2	5,55	2,97	
		3	4,70	2,51	
		4	4,37	2,34	
	Shear, after 7 day water immersion	1	5,06	2,71	2,26
		2	3,58	1,91	
		3	4,58	2,45	
		4	3,68	1,97	

Os resultados apresentados neste trabalho referem-se apenas às amostras ensaiadas. Não se assume qualquer responsabilidade relativa à validade da amostragem, a menos que seja efetuada sob a direta responsabilidade do CTCV. A reprodução deste trabalho é autorizada apenas na sua forma íntegra. Para qualquer reprodução parcial será indispensável a autorização do CTCV por escrito.